



• BAUSTOFFPRÜFSTELLE Wismar GmbH • LÜBSCHER STRASSE 109 • 23966 WISMAR •

SAICOS COLOUR GmbH  
Carl-Zeiss-Straße 3

48336 Sassenberg

Wismar, 24.10.2014  
our signatur: Ha.

<b>Test report no.:</b>	<b>2496/14</b>
<b>Customer:</b>	SAICOS COLOUR GmbH
<b>Subject matter:</b>	Testing accordance - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test according to DIN 51130:2014-02
<b>Subject date:</b>	21.10.2014
<b>Samples received:</b>	22.10.2014
<b>test date:</b>	23.10.2014
<b>Name of the product:</b>	<b>9985 eco ecoline multi top sealing, matt with additive 9916 eco anti slip "R10", 3 times applied</b> Dimensions l/w [mm]: 100 x 50
<b>Number of samples:</b>	1 tiles
<b>Origin:</b>	as customer
<b>Sampling:</b>	The samples were provided by the customer.

The test report comprises 2 pages

*The test results related exclusively to the subject matter that was tested. The test report may not be copied, passed on to third parties or published in extracts without the written consent of BPS Wismar.*

**Determination of the anti-slip property according to DIN 51130:2014-02 "Testing of floor coverings -  
Determination of the anti-slip property - Workrooms and fields of activities with slip danger,  
walking method - Ramp test**

**Description of the panel:**

The light-brown wood parquet has a level surface.

**Preparation of the test cover:**

A test cover, size 100 x 50 cm was seamlessly produced by laying on a self-supporting, non-warping panel by the customer.


The cover was cleaned with a dry cloth before the start of the test.


**Mean angle of inclination:**


Test no.	Corrected overall angle of acceptance DIN 51 130 increased skid risk [ ° ]
1	18,0
2	17,3
3	18,0
4	15,5
5	14,1
6	14,5
<b>Mean value</b>	<b>16,2</b>
<b>Mean angle of inclination for assessment group shown below:</b>	<b>&gt; 10 - 19</b>

**Assessment group:**

In accordance with the test results obtained pursuant to the guidelines of DIN 51130;  
the tiles are to be classified in assessment group **R 10** .

  
Dipl.-Ing.(FH) Ch. Hartig  
Official in Charge



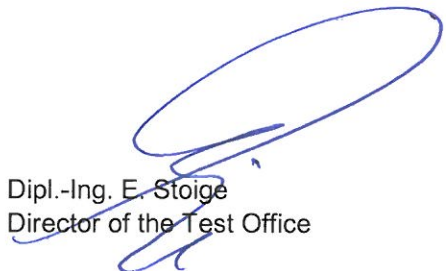  
Dipl.-Ing. E. Stoige  
Director of the Test Office