



• BAUSTOFFPRÜFSTELLE Wismar GmbH • LÜBSCHER STRASSE 109 • 23966 WISMAR •

SAICOS COLOUR GmbH
Carl-Zeiss-Straße 3

48336 Sassenberg

Wismar, 15.08.2013

our signatur: Ha.

Test report no.:	1769/13
Customer:	SAICOS COLOUR GmbH
Subject matter:	Testing accordance - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test according to DIN 51130:2010-10
Subject date:	13.08.2013
Samples received:	14.08.2013
test date:	15.08.2013
Name of the product:	wood pattern with coating in coloring: 3100 white 3317 silver gray 3328 teak 3381 hazel 3385 palisander 3319 black Dimensions l/w [mm]: 100 x 50
surface area:	applied with premium hartwachsoil in gloss 3310 ultra matt
Number of samples:	1 tiles
Origin:	as customer
Sampling:	The samples were provided by the customer.

The test report comprises 2 pages

The test results related exclusively to the subject matter that was tested. The test report may not be copied, passed on to third parties or published in extracts without the written consent of BPS Wismar.

Durch die DAkkS nach DIN EN ISO/IEC 17025 akkreditiertes Prüflaboratorium. Die Akkreditierung gilt nicht für die mit *) gekennzeichneten Prüfverfahren. Die Prüfergebnisse beziehen sich ausschließlich auf die untersuchten Prüfgegenstände. Der Prüfbericht darf ohne Genehmigung der BAUSTOFFPRÜFSTELLE Wismar GmbH nicht auszugsweise vervielfältigt, an Dritte weitergeleitet oder veröffentlicht werden.

ANSCHRIFT: Lübsche Straße 109, 23966 Wismar TELEFON: +49 (0)3841 76 23 06 TELEFAX: +49 (0)3841 76 30 78 E-MAIL: info@bps-wismar.de INTERNET: www.bps-wismar.de AMTSGERICHT SCHWERIN HRB 1958 STEUER-NR.: 080/106/00090 USt-IdNr.: DE 137436034 GESCHÄFTSFÜHRUNG: Dipl.-Ing. Ellen Stoige



Determination of the anti-slip property according to DIN 51130:2010-10 "Testing of floor coverings - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test

Description of the panel:

The brown wood flooring has a slightly woody structure, level surface.

Preparation of the test cover:

A test cover, size 100 x 50 cm was seamlessly produced by laying on a self-supporting, non-warping panel by the customer.


The cover was cleaned with a dry cloth before the start of the test.

Mean angle of inclination:


Test no.	Corrected overall angle of acceptance DIN 51 130 increased skid risk [°]
1	8,7
2	8,9
3	8,9
4	9,9
5	9,6
6	9,0
Mean value	9,2
Mean angle of inclination for assessment group shown below:	6 - 10

Assessment group:

In accordance with the test results obtained pursuant to the guidelines of DIN 51130;
the tiles are to be classified in assessment group **R 9**.


Dipl.-Ing.(FH) Ch. Hartig
Official in Charge

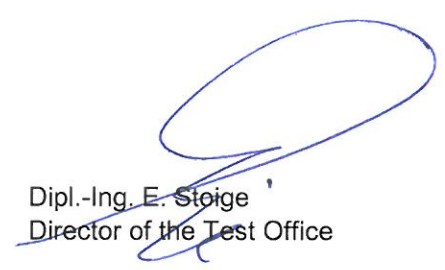


Dipl.-Ing. E. Stoige
Director of the Test Office